

INSTALLATION INSTRUCTIONS FOR

Remote Control Unit

Catalogue Number HE8407


PLEASE RETAIN THIS LEAFLET

CONTROLLER HE8407

The remote control switch box or HE8407 is for use with the 3 kW and 4.5 kW Screen Zone curtain heaters HE7402, 7420 & 8320, and the 6 kW Screen Zone curtain heater HE7426.

The unit comprises of one 32A double pole and two 20A switches in a surface mounting box, 166 mm x 86 mm x 40 mm deep.


The unit is supplied wired for use.

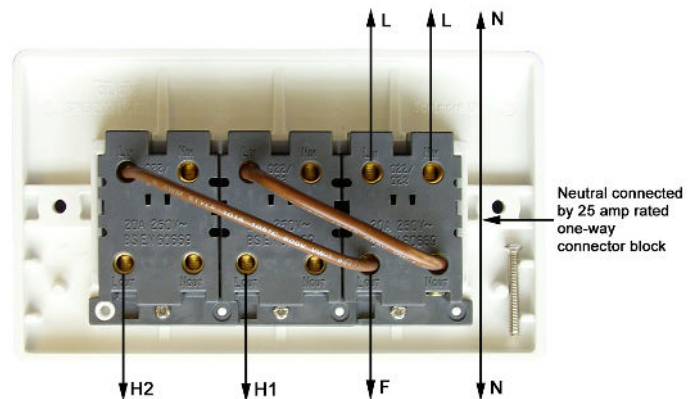

In the interest of progress the Company right to vary specifications from time to time without notice. The material listed is offered subject to the Company's General Conditions of Sale, a copy of which may be obtained upon request.

All wiring connected to the heater switches and 3-way terminal block should be removed and connections between the 4-way terminal block and the remote switch made as shown below. The neutral is not switched. A suitable double pole isolation switch should be incorporated in the circuit.

For safety reasons, a sound earth connection must always be made to the unit before use.

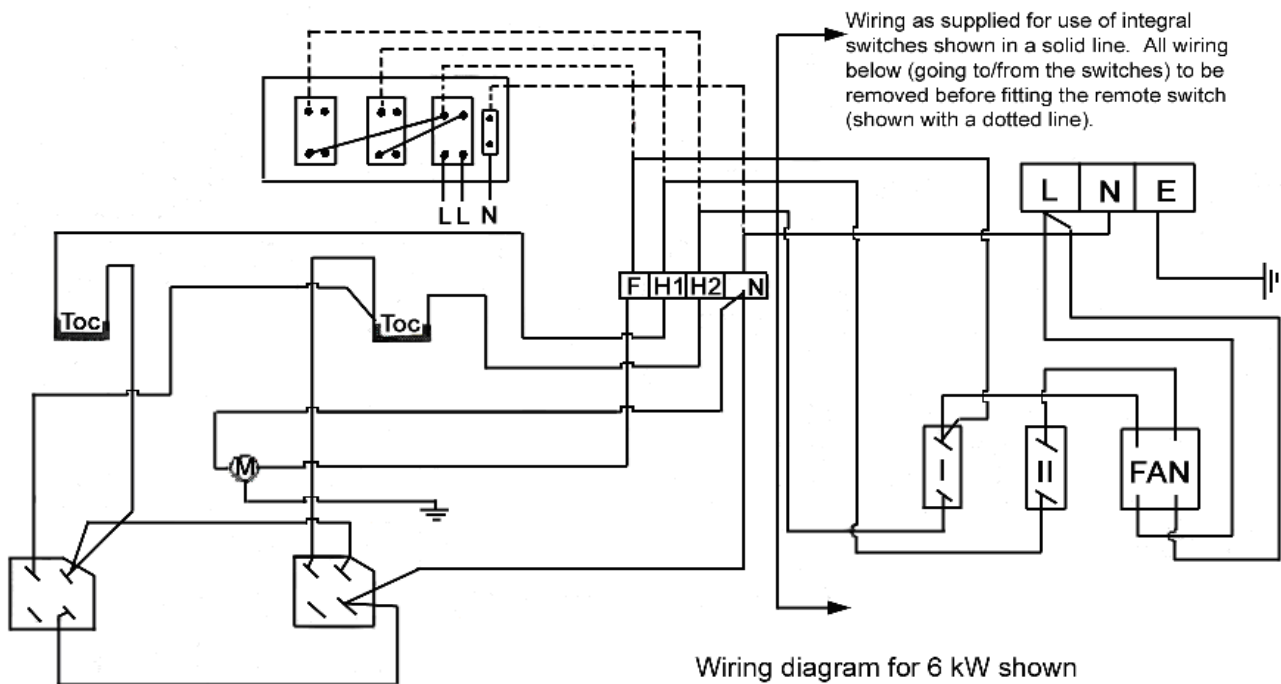

Declaration Of Conformity

In accordance with UK Government Guidance.

WE HEREBY CERTIFY THAT THE APPLIANCES DETAILED HEREON HAVE BEEN INSPECTED AND TESTED, AND CONFORM TO THE REQUIREMENTS OF THE FOLLOWING UK STATUTORY INSTRUMENTS WHERE APPLICABLE:

Electrical Equipment (Safety) Regulations 2016 SI. 2016 1101

Electromagnetic Compatibility Regulations 2016 SI. 2016 No. 1091

Radio Equipment Regulations 2017 SI. 2017 No. 1206

The Ecodesign for Energy Related Products and Energy Information (Amendment) (EU Exit) Regulations 2019. SI. 2010 2617

The Restriction of use of Certain Hazardous Substances. SI. 2012 No. 3032

The Waste Electrical and Electronic Equipment Regulations 2013. SI. 2013 No. 3113

Security Requirements for 'Connectable Products' PTSI Act 2022

Transposed standards used:

- **BS EN 55014 (2006)**
- **BS EN 301489.1 & .3**
- **BS EN 300220.1 & .2**
- **BS EN 60730.2.9**
- **BS EN 60335.1 (2012)**
- **BS EN 60335.2.30 (2009)**
- **ETSI BS EN 303645**

PART NUMBER AND DESCRIPTION OF APPLIANCE:

HE8407

NAME OF RESPONSIBLE PERSON:

DAVID O'SULLIVAN

POSITION:

OPERATIONS MANAGER

DATE:

24/06/24



FM 12671

CONSORT EQUIPMENT PRODUCTS LTD.

THORNTON INDUSTRIAL ESTATE, MILFORD HAVEN, PEMBROKESHIRE, SA73 2RT. UK
TEL: +44 1646 692172 FAX: +44 1646 695195. E-MAIL: ENQUIRIES@CONSORTEPL.COM
WWW.CONSORTEPL.COM